



G-STRUT 4100 13th Street SW, Canton OH 44710
 Phone: 866.997.8788 – Fax: 330.477.0626
www.gregorystrut.com

SINGLE PIPE WITH TRANSVERSE AND LONGITUDINAL BRACE




SEISMIC CRITERIA
 $\alpha_p = 2 \frac{1}{2}$ $R_p = 6$

VERTICAL FORCE
 $F_{pv} = 0.280 \text{ g (ASD)}$

MATERIALS LIST

- 1 G582 Strut (QTY 3)
- 2 1/2" Ø All Thread (QTY 1)
- 3 Seismic Hinges (QTY 4)
- 4 Conduit/Pipe Clamp (QTY 2)
- 5 GRS375062 (QTY 2)

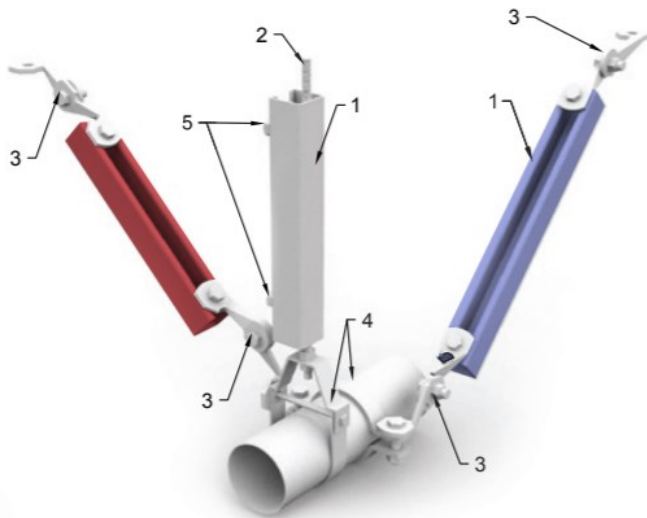

PIPING MEETING ASME B31 REQUIREMENTS

☰	WEIGHT (TOTAL PER FT.)	HANGER DIA. AND SPACING	SEISMIC PARAMETERS	BRACE SPACING (FT.)				
				$S_{DS} \leq 1.00$		$1.00 < S_{DS} \leq 2.00$		
				TRANS. SPACING (T)	LONGIT. SPACING (L)	TRANS. SPACING (T)	LONGIT. SPACING (L)	
IMPORTANCE FACTOR, I_p	$I_p = 1.00$	25 plf	1/2"Ø	$z/h \leq 0.5$	56'0"	56'0"	28'0"	56'0"
			14'0"	$z/h \leq 1.0$	56'0"	56'0"	28'0"	56'0"
	50 plf	1/2"Ø	$z/h \leq 0.5$	24'0"	48'0"	12'0"	24'0"	
		12'0"	$z/h \leq 1.0$	24'0"	48'0"	12'0"	24'0"	
$I_p = 1.50$	25 plf	1/2"Ø	$z/h \leq 0.5$	48'0"	72'0"	12'0"	24'0"	
		12'0"	$z/h \leq 1.0$	36'0"	72'0"	12'0"	24'0"	
	50 plf	1/2"Ø	$z/h \leq 0.5$	20'0"	40'0"	10'0"	20'0"	
		10'0"	$z/h \leq 1.0$	20'0"	40'0"	10'0"	20'0"	

PROJECT INFORMATION	APPROVAL STAMP
Project:	Notes:
Address:	
Contractor:	
Engineer:	
Date:	
Approved <input type="checkbox"/> Approved as Noted <input type="checkbox"/> Not Approved <input type="checkbox"/>	